

Tahoe City Public Utility District
 P. O. Box 5249
 Tahoe City, CA 96145
www.tcpud.org
 530-583-3796



Tahoe City Public Utility District 2021 Tahoe Cedars Water System - Annual Water Quality Consumer Confidence Report

**Este informe contiene información muy importante sobre su agua potable.
 Tradúzcalo o hable con alguien que lo entienda bien**

To Our Valued Tahoe Cedars Customers:

The enclosed information is a report of the quality and laboratory analysis of the drinking water for the Tahoe Cedars Water System during the calendar year of 2021. On page two you will find a table showing data from samples collected and contains all detected contaminants in the water, as well as general information on water quality and different standard health effect language for various contaminants. This report can also be viewed at our website at: www.tcpud.org/ccr/tahoeceadars.pdf.

While water supplied to Tahoe Cedars is classified as either treated surface water or groundwater, it is important for you to understand all potential sources of drinking water. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline (1-800-426-4791). Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. U.S. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:


- Microbial contaminants such as viruses and bacteria that may come from sewage treatment plants, septic systems and wildlife.
- Inorganic contaminants such as salts and metals that can be naturally occurring or result urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and Herbicides which may come from a variety of sources such as storm water runoff and residential uses.
- Organic chemical contaminants including synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- Radioactive contaminants which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (U.S. EPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Board regulations also establish limits for contaminants in bottled water that provide the same protection for public health.

For questions or additional information please call Utilities Superintendent, Dan Lewis, at (530) 580-6330 or the USEPA Safe Drinking Water Hotline at (800) 426-4791 or view their website: <https://www.epa.gov/ground-water-and-drinking-water>. To obtain general District information, to express your views, or to participate in the decision-making process of the TCPUD; you are welcome to attend or view online our Board of Directors meetings. The District Board of Directors meeting schedule, agendas and videos are available on our website www.tcpud.org or contact the District Clerk's office at (530) 580-6052.

Where does your water come from?

In 2021, approximately 99.87 % of the water supplied to the system was from the Elm Street Well. Approximately 0.13 % was provided through the new interconnection by the water source in the McKinney-Quail System. All of the drinking water supplied to the water system is classified as groundwater. Sources include wells drilled deep into the ground, providing clean, high quality water that consistently meets all standards without significant treatment. The Tahoe Cedars system serves all residents between 6650 to 7181 West Lake Blvd on the lake side and the Tahoe Cedars Subdivision area. A Source Water Assessment for each active source was completed in 2002 or 2014. The source is considered most vulnerable to the following activity not associated with any detected contaminants: Sewer Collection Systems and Surface Water. There have been no contaminants detected in the water supply, however the sources are still considered vulnerable to the activities located near the drinking water source. Well construction and security measures should provide protection from most contaminating activities. Copies of all source water assessments are available for review at the TCPUD offices during regular business hours. Upon request, copies can be sent to individuals by contacting the Utilities Superintendent at (530) 580-6330.

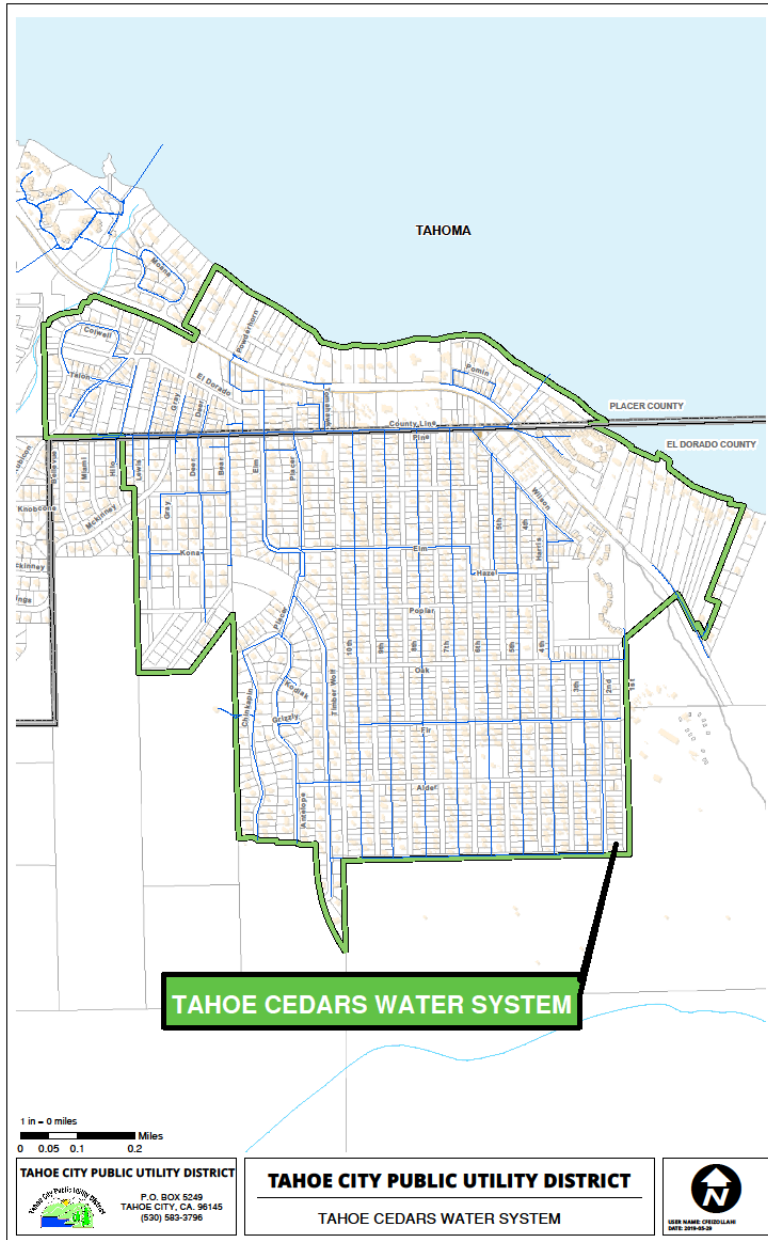

Water Conservation Links:

- www.saveourwater.com/
- www.h2ouse.org/water-conservation/
- www.tcpud.org/utility-services/water/water-conservation
- www.epa.gov/watersense/
- www.wateruseitwisely.com/100-ways-to-serve

Este informe contiene información importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.

Detected Compounds The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old. If a substance or contaminant is not listed, it is either not detected above the detection limit in our sources or not required to be reported or sampled.

Identify your system >							
		Tahoe Cedars	McKinney / Quail			MCL Violation	Major Origins in Drinking Water
Contaminant (Units)	Sample Year	MCL	PHG (MCLG)	Elm Street Well	Crystal Way Well		
Secondary Drinking Water Standards (SDWS)							
Calcium (ppm)	2016 (2014)	N/A	N/A	17	(11)	N/A	Leaching from natural deposits
Chloride (ppm)	2016 (2014)	500	N/A	1.8	(0.3)	N/A	Leaching from natural deposits
Sodium (ppm)	2016 (2014)	N/A	N/A	5.9	(4.4)	N/A	Leaching from natural deposits
Specific Conductance [E.C.] (µS/cm)	2016 (2014)	1600	N/A	140	(119)	NO	Substances that form ions when in water
Sulfate (ppm)	2014	500	N/A	ND	0.5	NO	Runoff/leaching from natural deposits
Total Alkalinity [as CaCO3] (ppm)	2016 (2014)	N/A	N/A	65	(54.6)	NO	Leaching from natural deposits
Total Dissolved Solids (ppm)	2016 (2014)	1000	N/A	97	(96)	NO	Erosion of natural deposits
Total Hardness [as CaCO3] (ppm)	2016 (2014)	N/A	N/A	58	(43)	N/A	Leaching from natural deposits
Turbidity (NTU)	2016 (2014)	5	N/A	0.15	(0.13)	NO	Movement of sediments and minute deposits
Radiological Monitoring							
Radon 222 (pCi/L)	2003	N/A	N/A	N/A	465	N/A	Erosion of natural deposits
Disinfection By-products and Disinfectant Residual							
Total Trihalomethanes [TTHM] (ppb)	2021	80	N/A	N/A	0.52	NO	By product of drinking water chlorination
Haloacetic Acids [HAA5] (ppb)	2021	60	N/A	N/A	ND	NO	
Chlorine residual (ppm)	2021	4 (MRDL)	4 (MRDLG)	N/A	RAA: 0.36 RANGE: 0.21-0.51	NO	Drinking water disinfectant added for treatment
Microbiological Monitoring							
Total Coliform (P/A)	2021	1P (in a month)	(0P)	86T/ 75A/ 11P (See Note 1)	40T / 39A / 1P	NO (See Note 2)	Naturally present in the environment
E-coli (P/A)	2021	(Note 2)	(0P)	86T/ 86A/ 0P	40T / 40A / 0P	NO	Human and Animal Fecal Waste

Note 1: Total Coliform (for Tahoe Cedars System): Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially harmful, waterborne pathogens may be present or that a potential pathway exists through which contamination may enter the drinking water distribution system. When this occurs, we are required to conduct an assessment to identify and correct any discovered problems. During 2021, we were required to conduct one **Level 1 Assessment**, (a study of the water system to identify potential problems and determine, if possible, why total coliform bacteria had been discovered in our water system) which was completed in November. During our assessment we concluded that water and debris from a heavy rain event built up around the upper tank entry hatch and possibly entered the tank. We resolved this issue by re-sealing the hatch, installing angle iron as a diversion for future incidences, and temporarily disinfecting the distribution system with chlorine. Once all chlorine residuals had diminished, additional samples were immediately collected and the results showed no further coliforms present.

Note 2: Please note the MCL for Total Coliform and E.coli changed on 7/1/21, with California adopting the Federal Revised Total Coliform Rule. There is no longer an MCL for Total Coliform, and the MCL for E.coli changed from 0 to “Routine and repeat samples are total coliform-positive and either is *E. coli*-positive or system fails to take repeat samples following an *E. coli*-positive routine sample or system fails to analyze a total coliform-positive repeat sample for *E. coli*”. The revised rule maintains the purpose to protect public health by ensuring the integrity of the drinking water distribution system and monitoring for the presence of microbials (i.e., total coliform and *E. coli* bacteria). The U.S. EPA anticipates greater public health protection, as the rule requires water systems that are vulnerable to microbial contamination to identify and fix problems. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment to determine if any sanitary defects exist. If found, these must be corrected by the water system. The state Revised Total Coliform Rule became effective 7/1/21.

Lead and Copper Sampling Results							
Water System	Constituent	Year Sampled	# of Sites Sampled	90th % Results	# of Sites Exceeding Action Level	Action Level	PHG
Tahoe Cedars	Lead (ppb)	2021	10	1.7	0	15	0.2
	Copper (ppm)		10	0.23	0	1.3	0.3
Zero schools requested Lead sampling							
Typical Sources:	Lead: Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits						
	Copper: Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives						

Health Effects and General Information

Lead: If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. TCPUD is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/lead>.

Terms and Abbreviations Used in This Report

(2014)	Results shown in parentheses were for samples collected in the year shown in parentheses in the column labeled “Sample Year”		
Δ	Number of tests absent of bacteria	pCi/L	Picocuries Per Liter: Measure of radioactivity per 1 liter of water.
E.C.	Electrical Conductivity	PDWS	Primary Drinking Water Standards. MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.
MCL	Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.	PHG	Public Health Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.
MCLG	Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.	ppb	Parts Per Billion: Parts contaminant for every 1 billion parts of water.
MRDL	Maximum Residual Disinfection Level: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.	ppm	Parts Per Million: Parts contaminant for every 1 million parts of water.
MRDLG	Maximum Residual Disinfection Level Goal: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.	RAA	Running Annual Average
N/A	Not Applicable	SDWS	Secondary Drinking Water Standards. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
N/R	Not Regulated or Not Required	T	Number of tests for bacteria (Laboratory analysis)
NTU	Nephelometric Turbidity Unit: Measure of water clarity using light scattering	TT	Treatment Technique: A required process intended to reduce the level of contaminant in drinking water.
P	Number of tests detecting presence of bacteria	Units	Number of units measured
P / Δ	Presence / Absence	µS/cm	Microsiemens Per Centimeter: Measure of electrical current flow through a solution.